


SITE MAP LOCATION

**LEGEND:**

APPLICATION SITE BOUNDARY	
LANDS IN APPLICANT'S CONTROL	
EXISTING RIGHT OF WAY / WAYLEAVE	
Proposed 4m Wide Access Path For Details Refer to Dwg. A1045-CSE-HEL-XX-DR-C-2031	
220 kV GRID ROUTE:	
PROPOSED 220 kV UG CIRCUIT 1 GUNNOCKS TO WOODLAND	
PROPOSED 220 kV UG CIRCUIT 2 GUNNOCKS TO CORDUFF	
PROPOSED 8m JOINT BAYS	
GROUND LEVEL	
EXISTING SERVICES	
EXISTING ESB	
EXISTING ESB OVERHEAD	
EXISTING GAS	
EXISTING TELECOMS	
EXISTING FOUL	
EXISTING WATERMAIN	

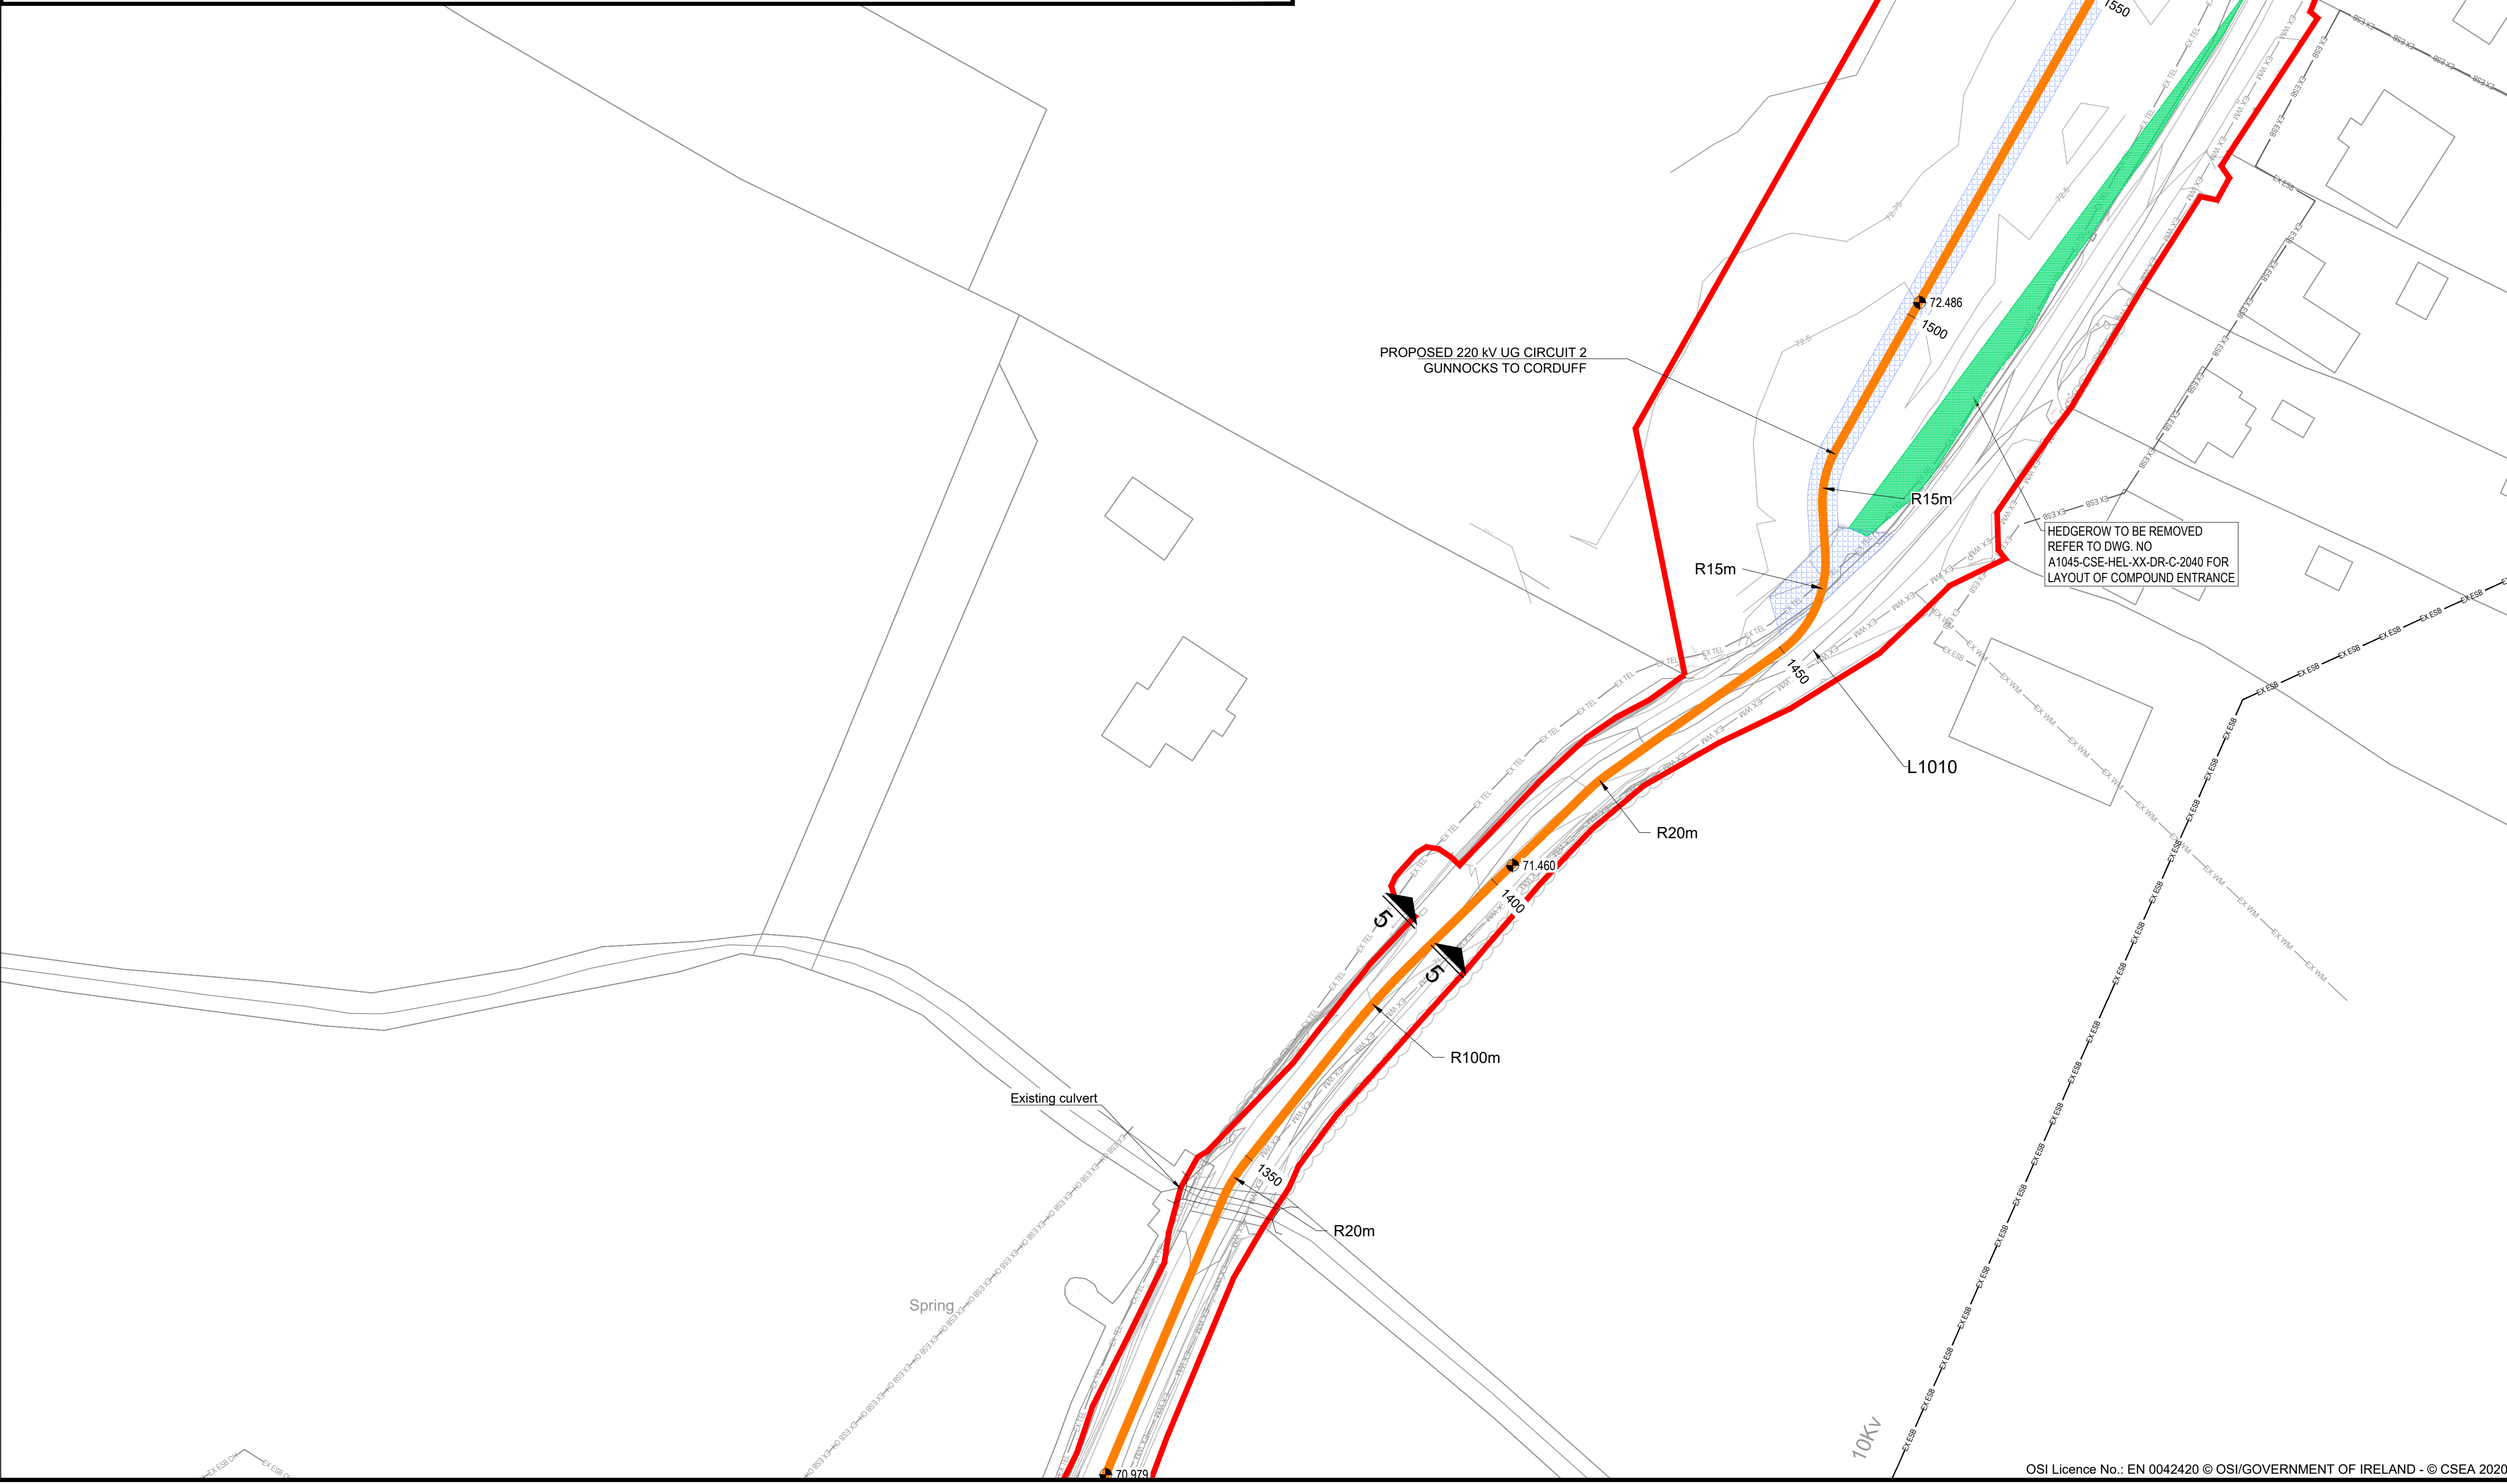

Rev	Description	Drawn	Checked	Date
----	----	----	----	----
P02	ISSUE FOR PLANNING	ZS	CD	30/07/2020
P01	DRAFT FOR PLANNING	ZS	CD	17/07/2020

Clifton Scannell Emerson Associates Limited  
Consulting Engineers,  
Seaforth Lodge,  
Castledawson Avenue,  
Blackrock, Co. Dublin,  
Ireland, A94 P768  
T: +353 1 288 5006  
F: +353 1 283 3466  
E: info@csea.ie  
W: www.csea.ie

Client	ENGINE NODE		
Project	ENGINE NODE 220 KV SUBSTATION AND GRID CONNECTION		
Dwg. Title	PROPOSED 220 KV ROUTE LAYOUT PLAN & SECTION SH 5 OF 13		
Drawn By	PH	Date	23-04-2020
Checked By	CD	Scale	1:500 @ A1
Project Code	A1045 - CSE - HEL - XX - DR - C - 2015	Zone/Phase	
Status Code	S2	Suitability Description	FOR INFORMATION
Revision	P02	Project Status	PLANNING